


# State of Utah *E coli* + Flow Chart

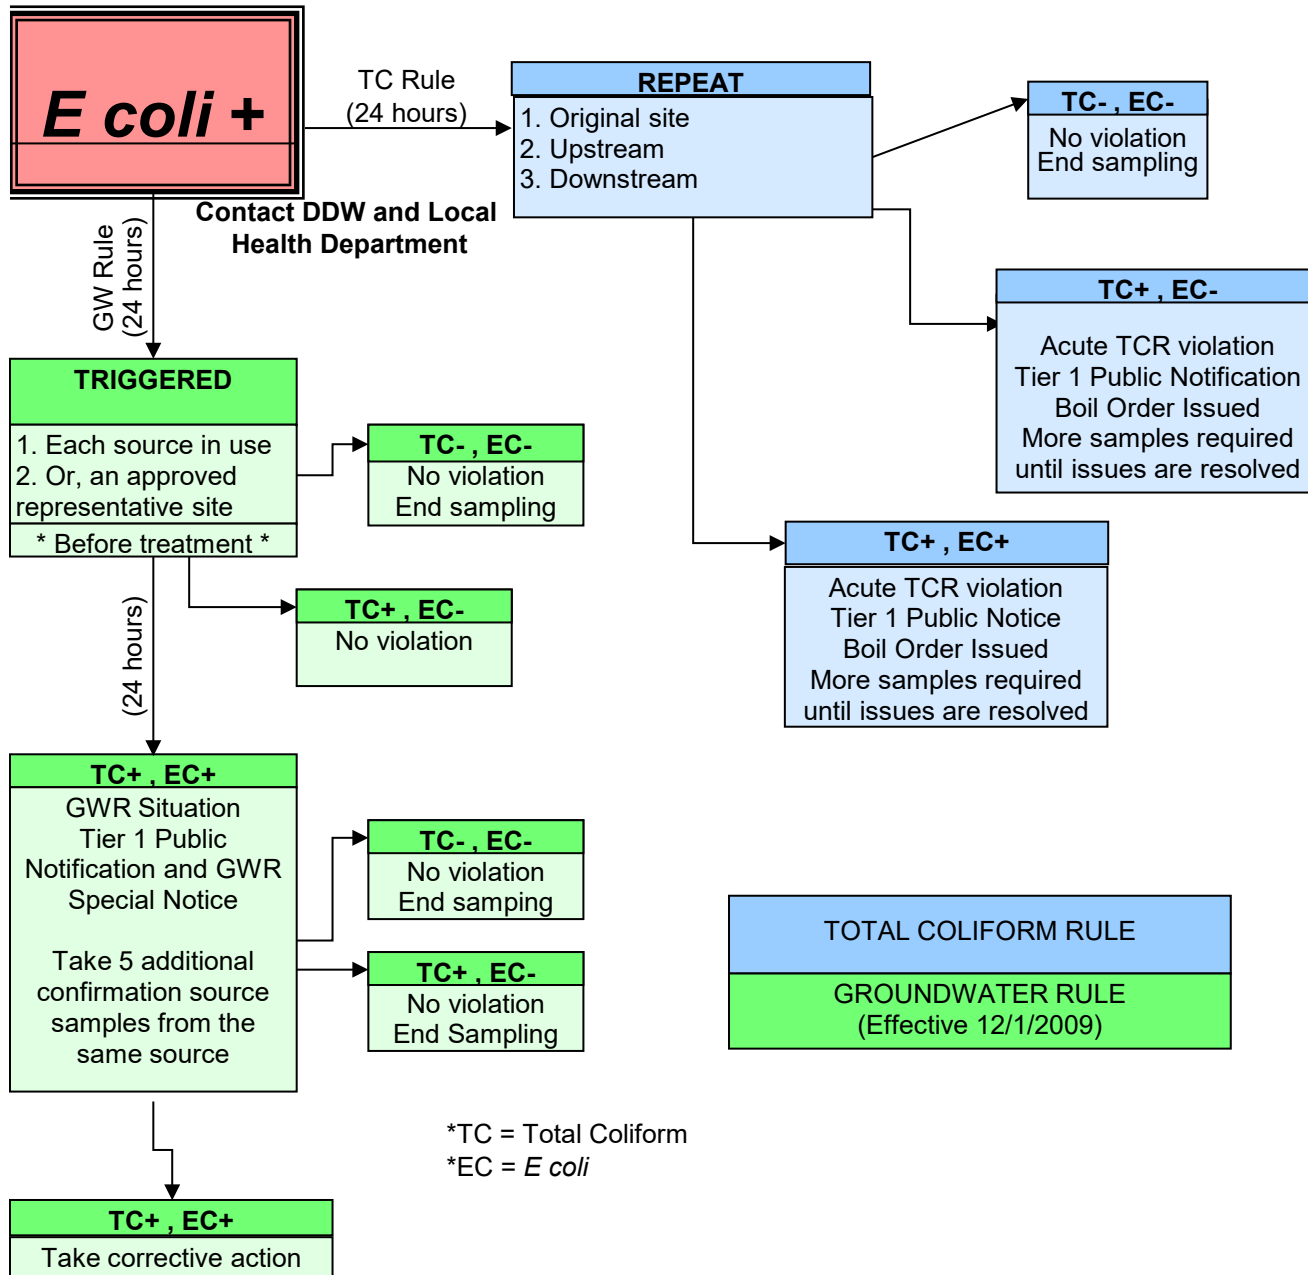

PUBLIC NOTIFICATION
<b>Tier 1</b> Acute Quality Violation Provide public notice within 24 hrs: See Boil Order Instructions for more information. Report to DDW & Local Health Dept
Provide <b>Boil Order - FAQ</b> or link to the information. Outlines common facts and questions about safe water use during a Boil Order.
<b>Complete Level 2 Site Assessment:</b> in conjunction with the Local Health Department and DDW. Begin and monitor corrective action.
<b>Boil order Lift:</b> Collect 2 sets of repeat samples 24 hours apart after problem has been corrected in order to lift boil order

SPECIAL NOTICE
<b>Tier 1</b> GWR Situation -Fecal indicator-positive source -Uncorrected significant deficiencies -Provide Special Notice annually until DDW determines the significant deficiencies are corrected, or if fecal contamination is addressed. -Will move forward with DDW Vulnerable Source Assessment Group