


State of Utah Bacteriological Flow Chart

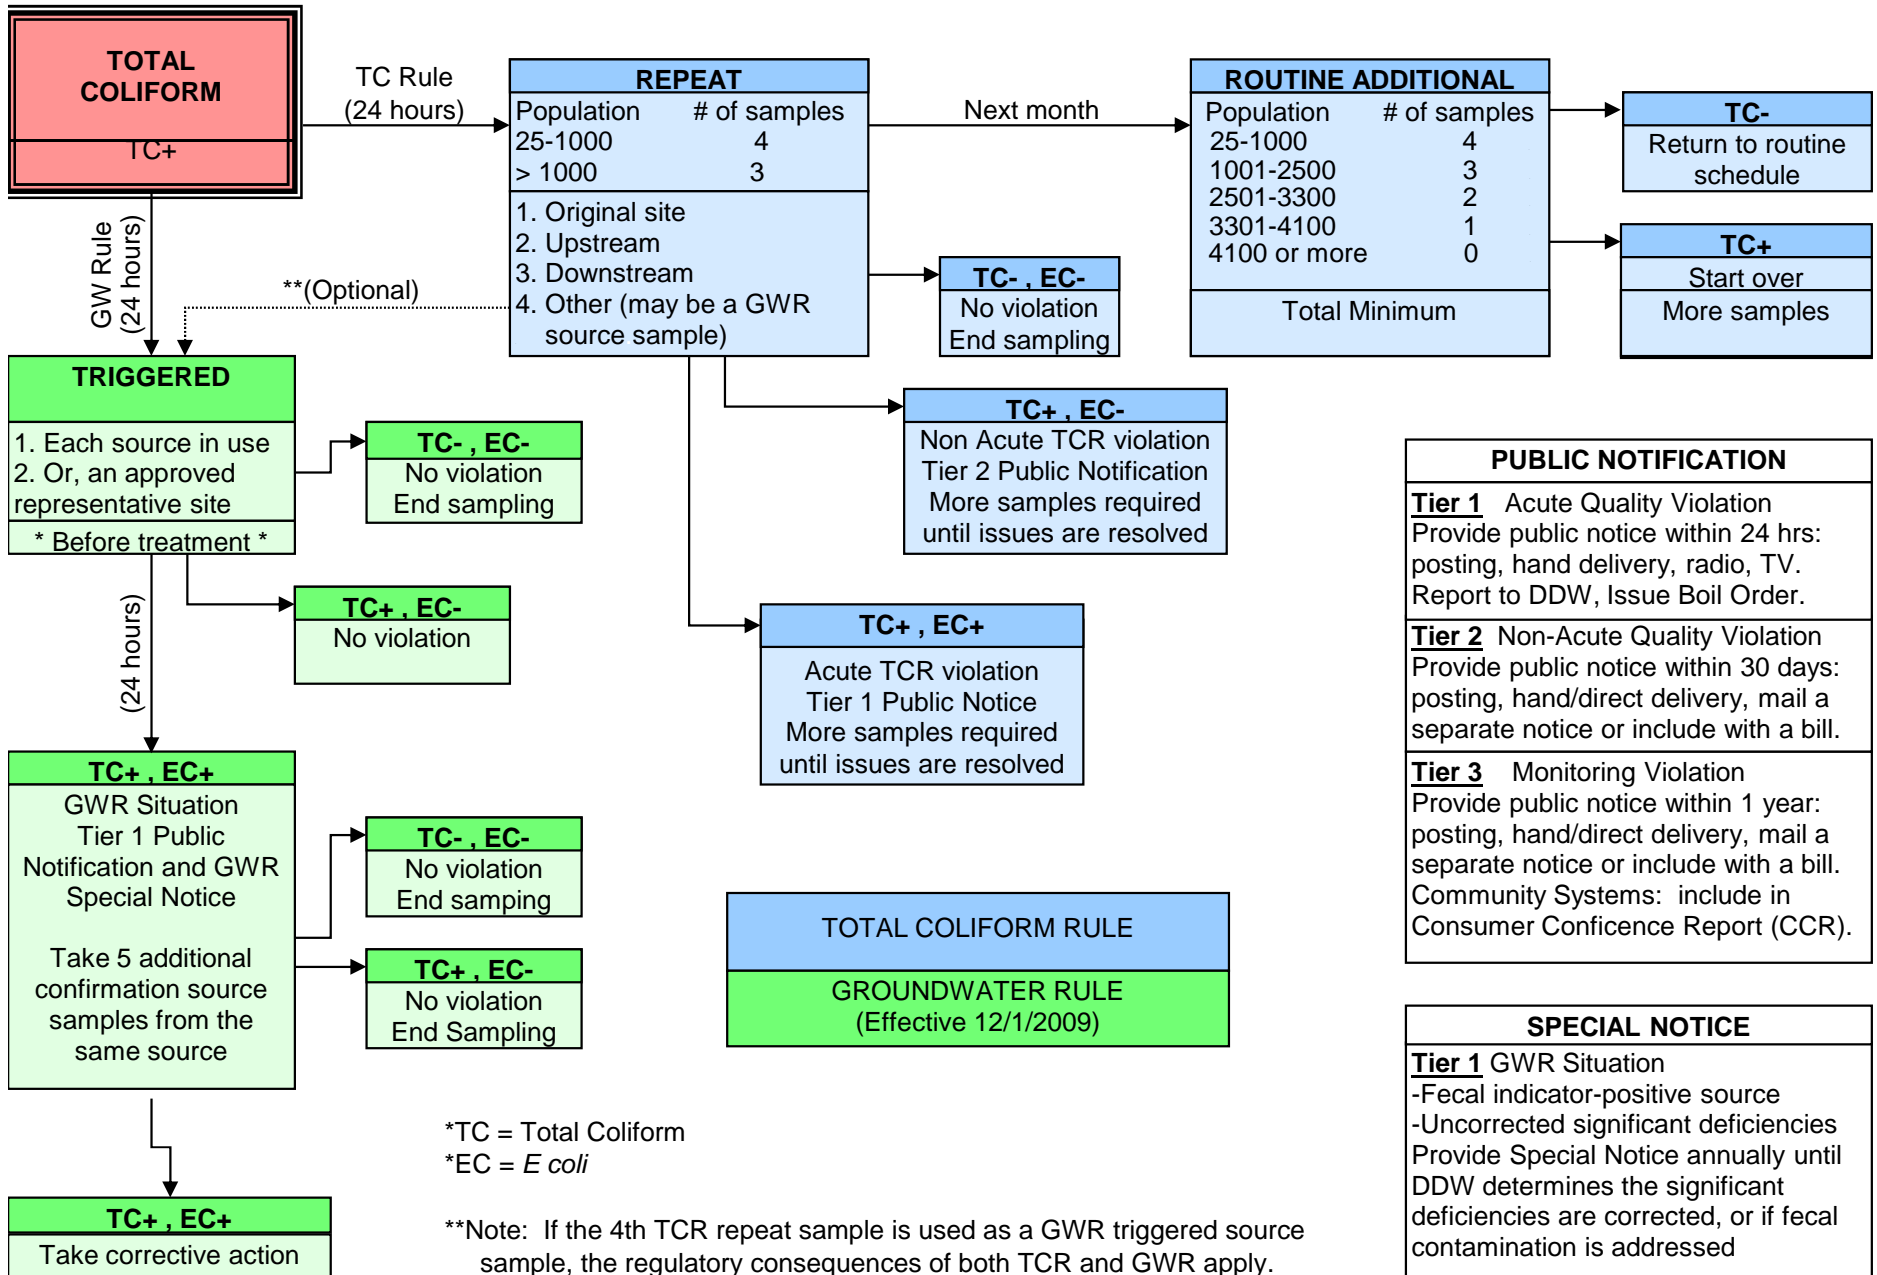

PUBLIC NOTIFICATION	
Tier 1 Acute Quality Violation	Provide public notice within 24 hrs: posting, hand delivery, radio, TV. Report to DDW, Issue Boil Order.
Tier 2 Non-Acute Quality Violation	Provide public notice within 30 days: posting, hand/direct delivery, mail a separate notice or include with a bill.
Tier 3 Monitoring Violation	Provide public notice within 1 year: posting, hand/direct delivery, mail a separate notice or include with a bill. Community Systems: include in Consumer Confidence Report (CCR).

SPECIAL NOTICE	
Tier 1 GWR Situation	-Fecal indicator-positive source -Uncorrected significant deficiencies Provide Special Notice annually until DDW determines the significant deficiencies are corrected, or if fecal contamination is addressed