



NSF Fact Sheet on Fluoridation Chemicals

Introduction

This fact sheet provides information on the fluoride containing water treatment additives that NSF has tested and certified to NSF/ANSI Standard 60: Drinking Water Chemicals - Health Effects. According to the latest Association of State Drinking Water Administrators Survey on State Adoption of NSF/ANSI Standards 60 and 61, 47 U.S. states require that chemicals used in treating potable water must meet Standard 60 requirements. If you have questions on your state's requirements, or how the NSF/ANSI Standard 60 certified products are used in your state, you should contact your state's Drinking Water Administrator.

Water fluoridation is the practice of adjusting the fluoride content of drinking water. Fluoride is added to water for the public health benefit of preventing and reducing tooth decay and improving the health of the community. The U.S. Centers for Disease Control and Prevention is a reliable source of information on this important public health intervention. For more information please visit www.cdc.gov/fluoridation/.

NSF certifies three basic products in the fluoridation category:

1. Fluorosilicic Acid (aka Fluosilicic Acid or Hydrofluosilicic Acid).
2. Sodium Fluorosilicate (aka Sodium Silicofluoride).
3. Sodium Fluoride.

NSF Standard 60

Products used for drinking water treatment are evaluated to the criteria specified in NSF/ANSI Standard 60. This standard was developed by an NSF-led consortium, including the American Water Works Association (AWWA), the American Water Works Association Research Foundation (AWWARF), the Association of State Drinking Water Administrators (ASDWA), and the Conference of State Health and Environmental Managers (COSHEM). This group developed NSF/ANSI Standard 60, at the request of the US EPA Office of Water, in 1988. The NSF Joint Committee on Drinking Water Additives continues to review and maintain the standard annually. This committee consists of representatives from the original stakeholder groups as well as other regulatory, water utility and product manufacturer representatives.

Standard 60 was developed to establish minimum requirements for the control of potential adverse human health effects from products added directly to water during its treatment, storage and distribution. The standard requires a full formulation disclosure of each chemical ingredient in a product. The standard requires testing of the treatment chemical products, typically by dosing these in water at 10 times the maximum use level, so that trace levels of contaminants can be detected. An evaluation of test results is required to determine if any contaminant concentrations have the potential to cause adverse human health effects. The standard sets criteria for the establishment of single product allowable concentrations (SPAC) of each respective contaminant. For contaminants regulated by the U.S. EPA, this SPAC has a default level not to exceed ten-percent of the regulatory level to provide protection for the consumer in the unlikely event of multiple sources of the contaminant, unless a lower or higher number of sources can be specifically identified. To address the health effects of the substances, Standard 60 requires that if EPA has not established a Maximum Contaminant Level for a substance, then the toxicology review and evaluation procedures contained in Annex A of NSF 60 should be followed to establish a SPAC.

All the three NSF certified products, Sodium fluoride, Sodium fluorosilicate, and Fluorosilicic acid, all dissociate to sodium, fluoride, and silicate ions in water. Sodium, fluoride, and silicates all have toxicological studies, fluoride has an MCL regulatory level, and silicate has an NSF maximum usage assessment. Fluorosilicates do not need a toxicological assessment specifically for the fluorosilicate ion, because it does not exist in potable water at the fluoride concentrations and pH levels of public drinking water (Finney WF, Wilson E, Callender A, Morris MD, Beck LW. Reexamination of hexafluorosilicate hydrolysis by fluoride NMR and pH measurement. *Environ Sci Technol* 2006;40:8:2572).

NSF Certification

NSF also developed a testing and certification program for these products, so that individual U.S. states and waterworks facilities would have a mechanism to determine which products were appropriate for use. The certification program requires annual unannounced inspections of production and distribution facilities to ensure that the products are properly formulated, packaged, and transported with safe guards against potential contamination. NSF also requires annual testing and toxicological evaluation of each NSF Certified product. NSF Certified products have the NSF Mark, the maximum use level, lot number or date code and production location on the product packaging or documentation shipped with the product.

The use of this standard and the associated certification program have yielded benefits in ensuring that drinking water additives meet the health objectives that provide the basis for public health protection. NSF maintains listings of companies that manufacture and distribute treatment products at www.nsf.org. These listings are updated daily and list the products at their allowable maximum use levels. In recognition of the important safeguards that NSF Standard 60 provides to public drinking water supplies, 47 U.S. States and 9 Canadian Provinces and Territories require drinking water treatment chemicals to comply with the requirements of the standard.

Treatment products that are used for fluoridation are addressed in Section 7 of NSF/ANSI Standard 60. The products are allowed to be used up to concentrations that result in a maximum use level of 1.2 mg/L fluoride ion in water. The NSF standard requires that the treatment products added to drinking water, as well as any impurities in the products, are supported by toxicological evaluation. The following text explains the rationale for the allowable levels established in the standard for 1) fluoride, 2) silicate, and 3) other potential contaminants that may be associated with fluoridation chemicals.

Fluoride

NSF/ANSI Standard 60 requires, when available, that the US EPA regulated maximum contaminant level (MCL) be used to determine the acceptable level for a contaminant. The EPA MCL for fluoride ion in water is 4 mg/L. The NSF Standard 60 single product allowable concentration (SPAC) for fluoride ion in drinking water from NSF Certified treatment products is 1.2 mg/L, or less than one-third of the EPA's MCL. Based on this the allowable maximum use level (MUL) for the NSF Certified fluoridation products are:

1. Fluorosilicic Acid: 6 mg/L.
2. Sodium Fluorosilicate: 2 mg/L.
3. Sodium Fluoride: 2.3 mg/L.

Silicate

There is no EPA MCL for silicate in drinking water. When an MCL does not exist for a contaminant, NSF/ANSI Standard 60 provides criteria to conduct a toxicological risk assessment of the contaminant and the development of a SPAC. NSF has established a SPAC for silicate at 16 mg/L. A fluorosilicate product, applied at its maximum use level, results in silicate drinking water levels that are substantially below the 16 mg/L SPAC established by NSF. For example, a sodium fluorosilicate product dosed at a concentration into drinking water that would provide the maximum concentration of fluoride allowed (1.2mg/L) would only contribute 0.8 mg/L of silicate – or 5 percent of the SPAC allowed by NSF 60.

Potential Contaminants

The NSF toxicology review for a chemical product considers all chemical ingredients in the product as well as the manufacturing process, processing aids, and other factors that have an impact on the contaminants present in the finished drinking water. This formulation review identifies all the contaminants that need to be analyzed in testing the product. For example, fluosilicic acid is produced by adding sulfuric acid to phosphate ore. This is typically done during the production of phosphate additives for agricultural fertilizers. The manufacturing process is documented by an NSF inspector at an initial audit of the manufacturing site and during each annual unannounced inspection of the facility. The manufacturing process, ingredients, and potential contaminants are reviewed annually by NSF toxicologists, and the product is tested for any potential contaminants. A minimum test battery for all fluoridation products includes metals of toxicological concern and radionuclides.

Many drinking water treatment additives, including fluoridation products, are transported in bulk via tanker trucks to terminals where they are transferred to rail cars, shipped to distant locations or transferred into tanker trucks, and then delivered to the water treatment plants. These tanker trucks, transfer terminals and rail cars are potential sources of contamination. Therefore, NSF also inspects, samples, tests, and certifies products at rail transfer and storage depots. It is always important to verify that the location of the product distributor (the company that delivers the product to the water utility) matches that in the official NSF Listing for the product (available at www.nsf.org).

NSF has compiled data on the level of contaminants found in all fluoridation products that have applied for, or have been listed by, NSF. The statistical results in Table 1 (attached) include the test results for these products, as well as the annual monitoring tests from the period 2000 to 2006. This includes 245 separate samples analyzed during this time period. The concentrations reported represent contaminant levels that would be expected when the product is dosed into water at the Maximum Use Level (MUL). Lower product doses would produce proportionately lower contaminant concentrations (e.g. a 0.6 mg/L fluoride dose would produce one half the contaminant concentrations listed in Table 1.)


Table 1 documents that there is no contamination of drinking water from the fluoridation products NSF has tested and certified. NSF issued previous summaries of contaminant levels in fluoridation products for earlier reporting periods in 1999 and 2003. While some contaminant levels in those earlier periods were slightly higher than the current data for certain contaminants, there has not been a single fluoride product tested since the initiation of the program in 1988 with a contaminant concentration in excess of its corresponding SPAC. The documented reduction of impurities for this most current time period is due, at least in part, to the

effectiveness of NSF/ANSI Standard 60 and the NSF certification program for drinking water treatment additives, and demonstrates the effectiveness of the program. The reduction in impurities is further attested to by an article in the Journal of the American Water Works Association entitled, "Trace Contaminants in Water Treatment Chemicals."¹

Arsenic

The results in Table 1 indicate that the most common contaminant detected in these products is arsenic, which is detected in 43% of the product samples. This means that levels of arsenic in 57% of the samples were non-detectable. Products were tested at 10 times their maximum use level in accordance to NSF/ANSI Standard 60. All detections were at levels below the Single Product Allowable Concentration (SPAC) if the product is added to drinking water at (or below) its maximum use level. The SPAC, as defined in NSF/ANSI Standard 60, is one tenth of the US EPA's MCL. The current MCL for arsenic is 10 ppb, the highest detection of arsenic from a fluoridation chemical was 0.6 ppb (shown on Table 1), and the average concentration was 0.12 ppb. The highest concentration of 0.6 ppb was detected because NSF/ANSI standard 60 requires testing the chemical at 10 times its maximum use level to detect these trace levels of contaminants.

Figure A

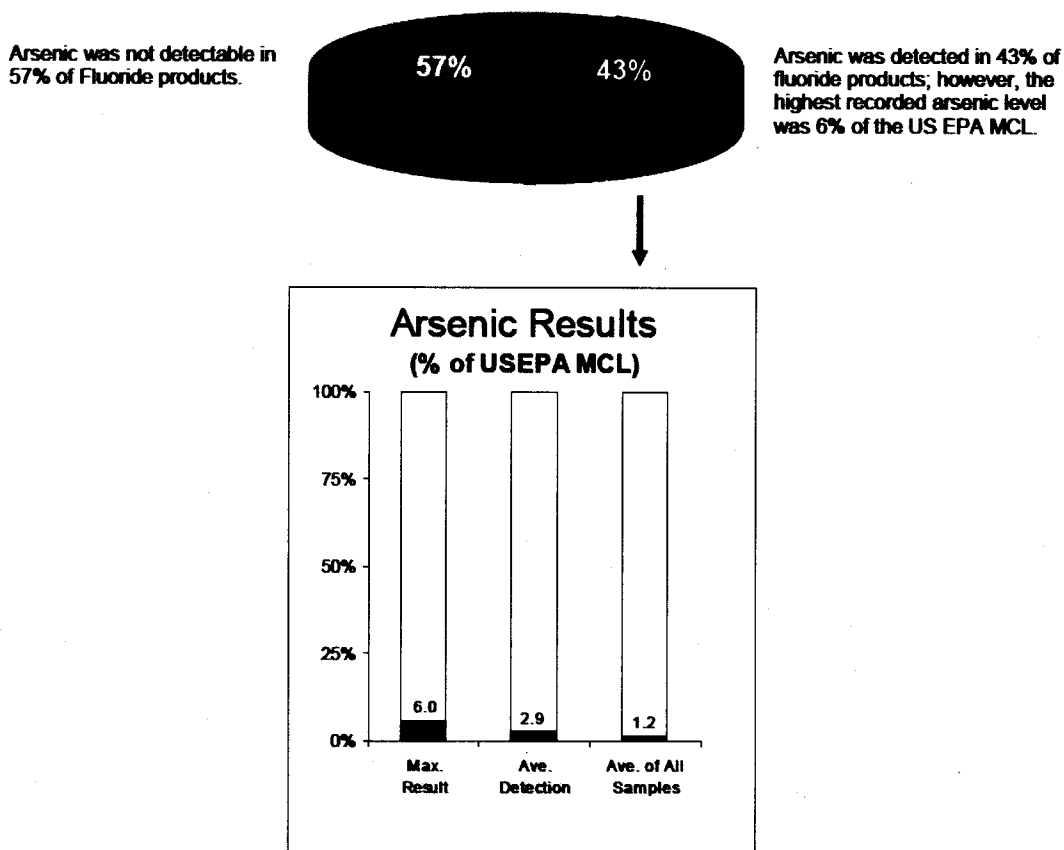


¹ Brown, R., et al., "Trace Contaminants in Water Treatment Chemicals: Sources and Fate." Journal of the American Water Works Association 2004: 96:12:111.

Copper

The second most common contaminant found, and on a much less frequent basis, is copper, and 97% of all samples tested had no detectable levels of copper. The average concentration of copper has been 0.02 ppb with 2.6 ppb being the highest concentration detected. This is well below the 130 ppb SPAC requirement of NSF 60.


Figure B

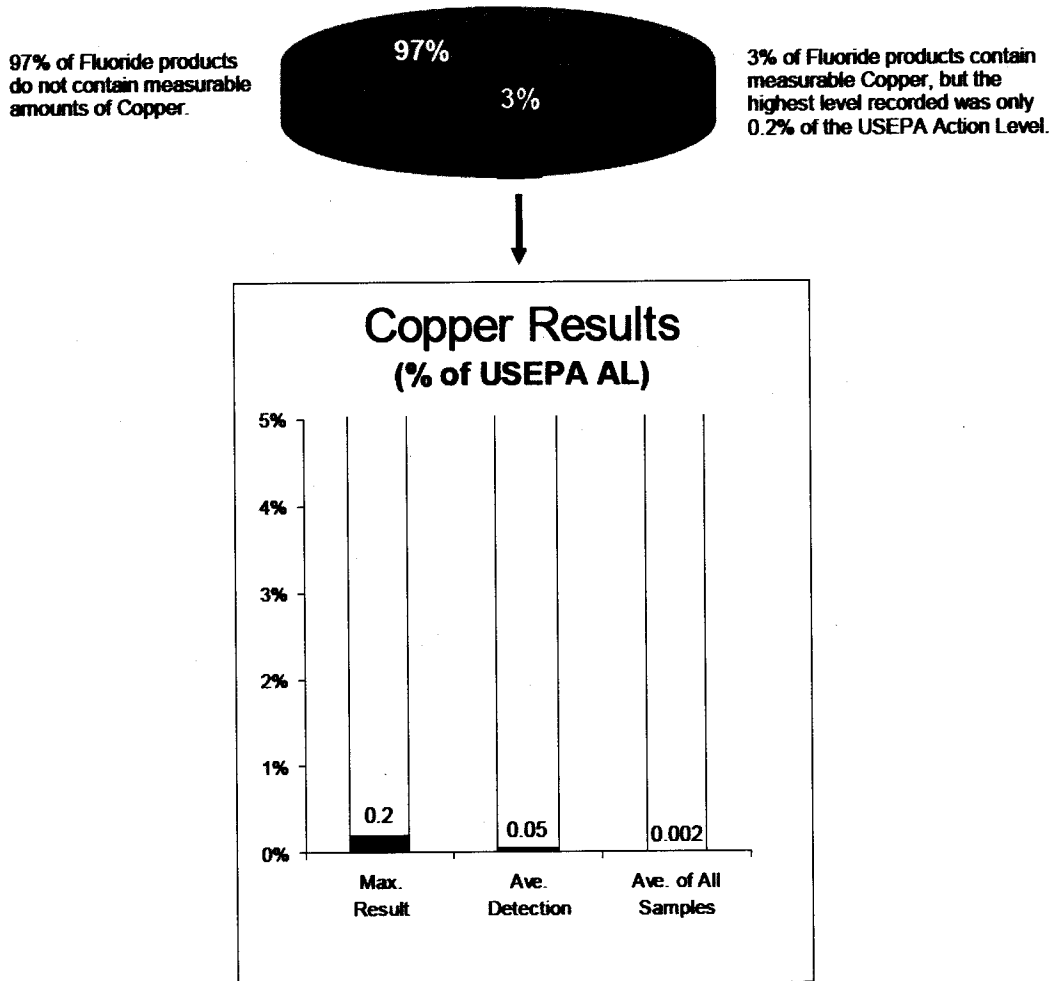

Lead

The third most common contaminant found is lead. It occurs on a much less frequent basis, and 98% of all samples tested had no detectable levels of lead. The average concentration of lead has been 0.005 ppb with 0.6 ppb being the highest concentration detected. This is well below the 1.5 ppb SPAC requirement of NSF 60.

Figure C

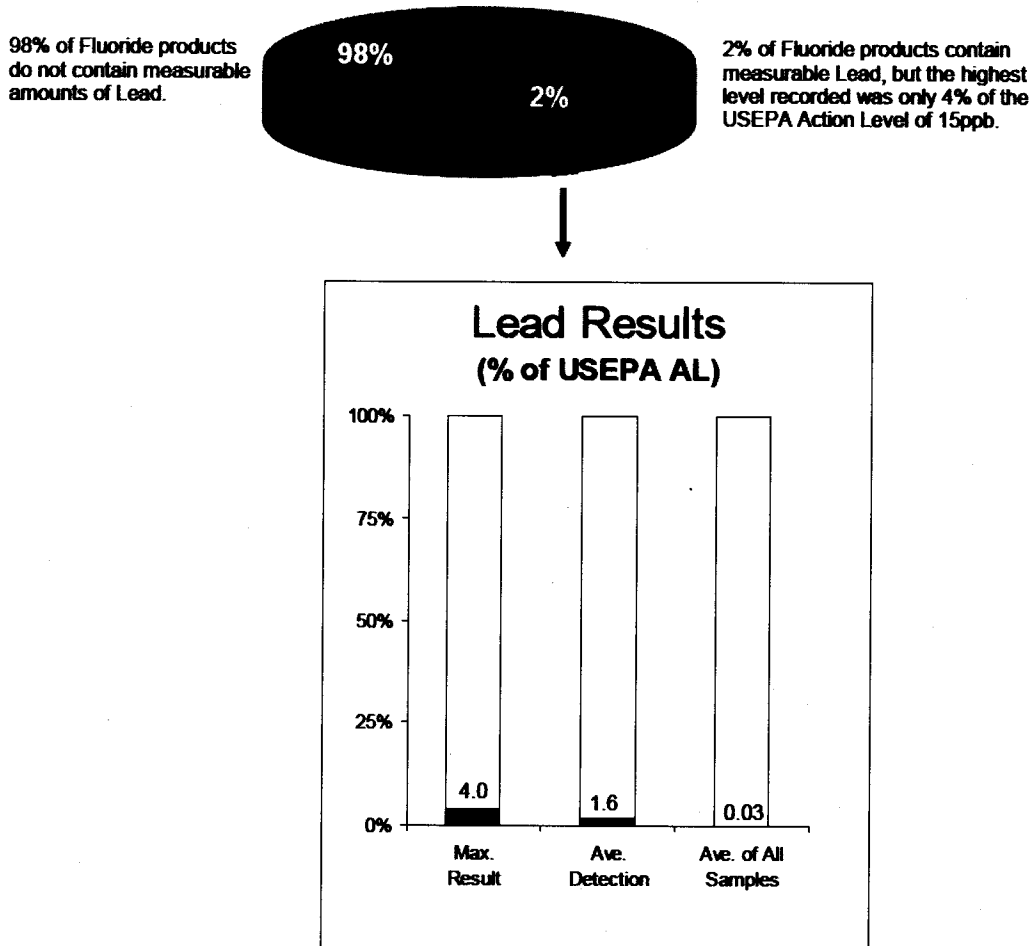

Radionuclides

Fluoridation products are also tested for radionuclides. All samples tested have not had any detectable levels of alpha or beta radiation.

Summary

In summary, the majority of fluoridation products as a class, based on NSF test results, do not add measurable amounts of arsenic, lead, other heavy metals, or radionuclide contamination to drinking water.

Additional information on fluoridation of drinking water can be found on the following web sites:

American Water Works Association (AWWA) Fluoridation Chemical Standards

<http://www.awwa.org/Bookstore/producttopicsresults.cfm?MetaDataID=121&navItemNumber=5093>

American Water Works Association (AWWA) position

<http://www.awwa.org/Advocacy/pressroom/fluoride.cfm>

American Dental Association (ADA) <http://www.ada.org/public/topics/fluoride/index.asp>

U.S. Centers for Disease Control and Prevention (CDC) <http://www.cdc.gov/fluoridation>

Table 1

	Percentage of Samples with Detectable Levels	Mean Contaminant Concentration in all samples (ppb)	Mean Contaminant Concentration in detectable samples (ppb)	Maximum Contaminant Concentration in detectable samples (ppb)	NSF/ANSI Standard 60 Single Product Allowable Concentration	US EPA Maximum Contaminant or Action Level
Antimony	0%	ND	ND	ND	0.6	6
Arsenic	43%	0.12	0.29	0.6	1	10
Barium	<1%	0.001	0.3	0.3	200	2000
Beryllium	0%	ND	ND	ND	0.4	4
Cadmium	1%	0.001	0.08	0.12	0.5	5
Chromium	<1%	0.001	0.15	0.2	10	100
Copper	3%	0.02	0.68	2.6	130	1300
Lead	2%	0.005	0.24	0.6	1.5	15
Mercury	<1%	0.0002	0.04	0.04	0.2	2
Radionuclides – alpha pCi/L	0%	ND	ND	ND	1.5	15
Radionuclides – beta mrem/yr	0%	ND	ND	ND	0.4	4
Selenium	<1%	0.016	1.95	3.2	5	50
Thallium	<1%	0.0003	0.04	0.06	0.2	2

June 2012

Abbreviations used in this Fact Sheet

ANSI – American National Standards Institute

AWWA – American Water Works Association

AWWARF – American Water Works Association Research Foundation

ASDWA – Association of State Drinking Water Administrators

COSHEM – Conference of State Health and Environmental Managers

EPA – U.S. Environmental Protection Agency

MCL – maximum contaminant level

mrem/yr – millirems per year – measurement of radiation exposure dose

MUL – Maximum use level

NSF – NSF International (formerly the National Sanitation Foundation)

ppb – parts per billion

PCi/L – pico curies per liter – concentration of radioactivity

SPAC – Single Product Allowable Concentration